

Issue Date: 04-11-2012  
Revision Date: 08-29-2018  
Renewal Date: 08-11-2019

**DIVISION: 06 – WOOD, PLASTICS, AND COMPOSITES**  
**Section: 06 63 00 – Plastic Railings**

**REPORT HOLDER:**  
**FAIRWAY ARCHITECTURAL RAILING SOLUTIONS**  
53 EBY CHIQUES ROAD  
MOUNT JOY, PA 17552  
(800) 598-5245  
[www.fairwayrailing.com](http://www.fairwayrailing.com)

**REPORT SUBJECT:**  
**CP300 Composite Railing (aka. FX-2 Guardrail Systems)**

### 1.0 SCOPE OF EVALUATION

**1.1** This Research Report addresses compliance with the following Codes:

- 2018 and 2015 *International Building Code*® (IBC)
- 2018 and 2015 *International Residential Code*® (IRC)

NOTE: This report references 2018 Code sections with 2015] Code sections shown in brackets where they differ.

**1.2** *FX-2 Guardrail Systems / CP300 Composite* has been evaluated for the following properties:

- Structural Performance
- Durability
- Surface Burning
- Decay Resistance
- Termite Resistance

**1.3** *FX-2 Guardrail Systems / CP300 Composite* has been evaluated for the following uses:

- *FX-2 / CP300 Railing Systems* are a guardrail under the definitions of the referenced codes. It is intended for use at or near the open sides of elevated walking areas of buildings and walkways as required by the codes.
- Guardrails are provided as level guards for level walking areas such as decks, balconies and porches.
- Guardrail systems recognized in this report may be used in One- and Two-Family Dwellings regulated by the IRC and all construction types regulated by the IBC in

accordance with IBC Section 705.2.3.1 [1406.3], Exception 2. Guardrails less than 42 inches high are limited to use in One- and Two-Family Dwellings (IRC). See Table 1 for additional restrictions based upon Use and Occupancy classification.

### 2.0 STATEMENT OF COMPLIANCE

*FX-2 / CP300 Railing Systems* complies with the Codes listed in Section 1.1, for the properties stated in Section 1.2 and uses stated in Section 1.3, when installed as described in this report, including the Conditions of Use stated in Section 6.0.

### 3.0 DESCRIPTION

**3.1** Level guardrails are provided with rail lengths up to 72 inches in length (measured between the inside of support posts) and an installed height of up to 42 inches. See Table 1 for qualified lengths and configurations.

**3.2** *FX-2 Guardrail Systems / CP300 Composite Railing* are an assemblage of an extruded Wood-Plastic Composite (WPC) material with a PVC capstock available in three colors: White, Black, and Walnut.

**3.3** The guardrail system includes a top rail, a bottom rail, vertical balusters, 4 inch square post sleeves, 5-1/4 inch square post sleeves, rail-to-post brackets, support block, decorative moldings, and post caps

**3.4** The top rail and sub-rail are co-extruded WPC rails with a PVC capstock. The top rail is contoured and has overall nominal sectional dimensions of 3-3/8 inches wide by 2-1/2 inches tall. The “H” sub-rail has overall nominal dimensions of 1-7/8 inch by 1-3/4 inch. See Figures 1-2.

**3.5** The bottom rail is co-extruded WPC with a PVC capstock contoured profile and is 2-1/4 inch wide by 2-1/8 inch high. See Figure 3.

**3.6** The infill area consists of 1-1/4 inch square, hollow, co-extruded WPC pickets with a PVC capstock. See Figure 10.



**3.7** Top and bottom rails are attached directly to structural supports with stainless steel mounting brackets. See Figures 4 through 6.

**3.8** Structural supports may be conventional wood framing. A co-extruded WPC post sleeve with PVC capstock with an overall width of 5-1/4 inches square is utilized to sleeve a conventional 4x4 wood post.

**3.9** A support block is installed between the lower rail and the deck surface midway between supports.

#### 4.0 PERFORMANCE CHARACTERISTICS

**4.1** The guardrail system described in this report has demonstrated the capacity to resist the design loadings specified in Chapter 16 of the IBC and Section R301 of the IRC when tested in accordance with ICC-ES AC174.

**4.2** Structural performance has been demonstrated for a temperature range from -20°F to 125°F.

**4.3** Materials used are deemed equivalent to preservative treated or naturally durable wood for resistance to weathering effects, decay, and attack from termites.

**4.4** The WPC material used in the guardrail system has a flame spread index of less than 200 when tested according to ASTM E 84.

#### 5.0 INSTALLATION

##### 5.1 General:

*FX-2 Guardrail Systems / CP300 Composite Railing* must be installed in accordance with the manufacturer's published installation instructions, the applicable Code, and this Research Report. A copy of the manufacturer's instructions must be available on the jobsite during installation.

##### 5.2 Application:

**5.2.1** The top and bottom rails are attached to structural supports as depicted in Figures 6 and 9 utilizing 316 stainless steel brackets. Also see Figure 4 and Table 2.

**5.2.2** The top and bottom rails may be attached to conventional wood supports; however, conventional wood

supports, including wood posts, are outside the scope of this report.

**5.2.3** 4x4 conventional wood posts may be covered by post sleeves, decorative caps, and moldings.

**5.2.4** Square WPC balusters are connected to the top and bottom rails using pin grip connectors. See Figure 10 and 11.

**5.2.5** The wood in the supporting structure including support posts shall have a specific gravity of 0.50 or greater (Southern Yellow Pine or better) and a minimum thickness to allow full penetration of the bracket mounting screws.

#### 6.0 CONDITIONS OF USE

**6.1** Installation must comply with this Research Report, the manufacturer's published installation instructions, and the applicable Code. In the event of a conflict, this report governs.

**6.2** Conventional wood supports including support posts for guardrails are not within the scope of this report and are subject to evaluation and approval by the building official. Supports must satisfy the design load requirements specified in Chapter 16 of the IBC and must provide suitable material for anchorage of the rail brackets (See 5.5 under "Installation"). Where required by the building official, engineering calculations and details prepared by a licensed design professional shall be provided.

**6.3** Compatibility of fasteners and other metallic components with the supporting structure, including chemically treated wood, is not within the scope of this report.

**6.4** *FX-2 Guardrail Systems / CP300 Composite Railing* is manufactured under a quality control program with inspections by Intertek Testing Services NA, Inc

#### 7.0 SUPPORTING EVIDENCE

**7.1** Drawings and installation instructions submitted by the manufacturer.

**7.2** Reports of tests in accordance with the performance requirements of ICC-ES AC174, Acceptance Criteria for Deck





Board Span Ratings and Guardrail Systems (Guards and Handrails), revised December 2014.

**7.3** The reports of testing demonstrate compliance with the performance requirements of ASTM D 7032-14 [-10a], Standard Specification for Establishing Performance Ratings for Wood-Plastic Composite Deck Boards and Guardrail Systems (Guards or Handrails).

**7.4** Documentation of an Intertek approved quality control system for the manufacturing of products recognized by this report.



### 8.0 IDENTIFICATION

*FX-2 Guardrail Systems / CP300 Composite Railing* are identified with the manufacturer's name (Fairway Architectural Railing Solutions), address and telephone number, the product name (*FX-2 Guardrail Systems / CP300 Composite Railing*), the following statements: "See CCRR-0176 at <https://whdirectory.intertek.com> for uses and performance levels" and "For use in One- and Two-Family Dwellings Only" (when applicable), the Intertek Mark as shown below, and the Code Compliance Research Report number (CCRR-0176).

### 9.0 OTHER CODES

This section is not applicable.

### 10.0 CODE COMPLIANCE RESEARCH REPORT USE

**10.1** Approval of building products and/or materials can only be granted by a building official having legal authority in the specific jurisdiction where approval is sought.

**10.2** Code Compliance Research Reports shall not be used in any manner that implies an endorsement of the product by Intertek.

**10.3** Reference to the <https://bpdirectory.intertek.com> is recommended to ascertain the current version and status of this report.

This Code Compliance Research Report ("Report") is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Report. Only the Client is authorized to permit copying or distribution of this Report and then only in its entirety, and the Client shall not use the Report in a misleading manner. Client further agrees and understands that reliance upon the Report is limited to the representations made therein. The Report is not an endorsement or recommendation for use of the subject and/or product described herein. This Report is not the Intertek Listing Report covering the subject product and utilized for Intertek Certification and this Report does not represent authorization for the use of any Intertek certification marks. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.





TABLE 1 – QUALIFIED GUARDRAIL SYSTEMS AND USE CATEGORIES

Railing System Dimensions <sup>1</sup>	Guardrail Type	Code Occupancy Classification
72 in by 42 in	Level	IBC – All Use Groups
72 in by 36 in or 42 in	Level	IRC – One- and Two-Family Dwellings

<sup>1</sup> Guardrails are qualified up to and including the listed maximum guardrail system dimensions for use in the referenced Code Occupancy Classification.

TABLE 2 – FASTENING SCHEDULE

Connection	Fastener Quantity and Size
Top Rail Bracket to Post <sup>1</sup>	Two #10-12 x 2-1/4 in pan head, stainless steel screws (0.183 in major diameter, 0.125 in minor diameter)
Top Rail Bracket to Top Rail <sup>1</sup>	One #10-12 x 3/4 in pan head, stainless steel screw <sup>2</sup> (0.190 in major diameter, 0.123 in minor diameter) Connects Bracket to Sub-Rail -and- One #10-12 x 1-3/4 in pan head, stainless steel screw <sup>3</sup> (0.182 in major diameter, 0.119 in minor diameter) Connects Bracket to Sub-Rail to Top Rail Cap
Sub-Rail to Top Rail Cap <sup>1,4</sup>	Two #10-12 x 1-3/4 in pan head, stainless steel screws (0.182 in major diameter, 0.119 in minor diameter)
Bottom Rail Bracket Mounting Screw to Post <sup>5</sup>	One #14-10 x 2 in pan head, stainless steel screw (0.250 in major diameter, 0.185 in minor diameter)
Bottom Rail Bracket to Bottom Rail	One #10-12 x 3/4 in pan head, stainless steel screw (0.190 in major diameter, 0.123 in minor diameter)
Support Block Bracket to Bottom Rail	One #10-12 x 3/4 in pan head, stainless steel screw (0.190 in major diameter, 0.123 in minor diameter)

<sup>1</sup> 5/32 in diameter pre-drill in post and/or rail

<sup>2</sup> Installed in the bracket slot closer to the post

<sup>3</sup> Installed in the bracket slot farther from the post.

<sup>4</sup> Fasteners located at quarter points relative to rail length.

<sup>5</sup> 3/16 in diameter pre-drill in post



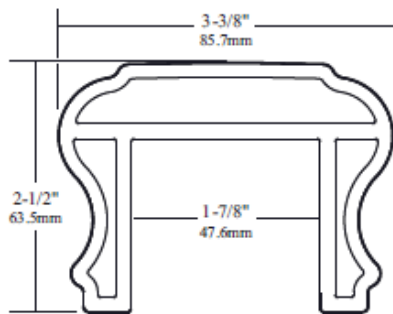


FIGURE 1 – TOP RAIL PROFILE

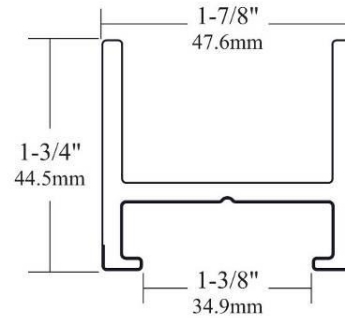


FIGURE 2 – SUB-RAIL PROFILE

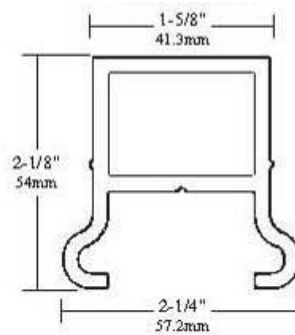


FIGURE 3 – BOTTOM RAIL PROFILE


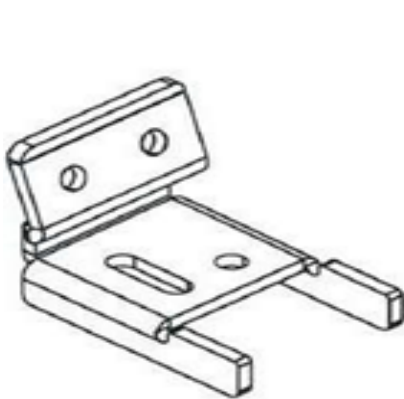


FIGURE 4 – TOP RAIL BRACKET

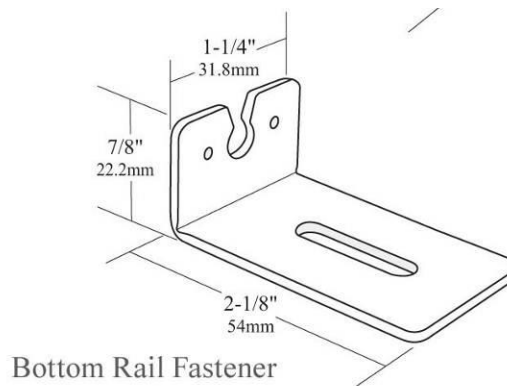

Bottom Rail Fastener

FIGURE 5 – BOTTOM RAIL BRACKET

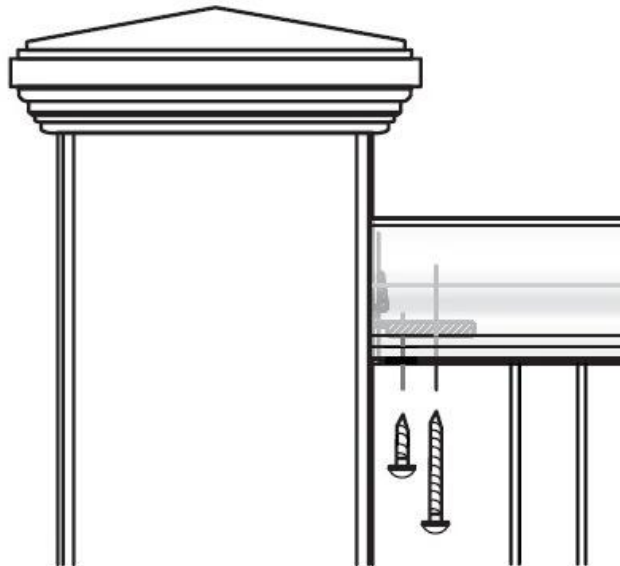


FIGURE 6 – TOP RAIL TO BRACKET CONNECTION DETAIL

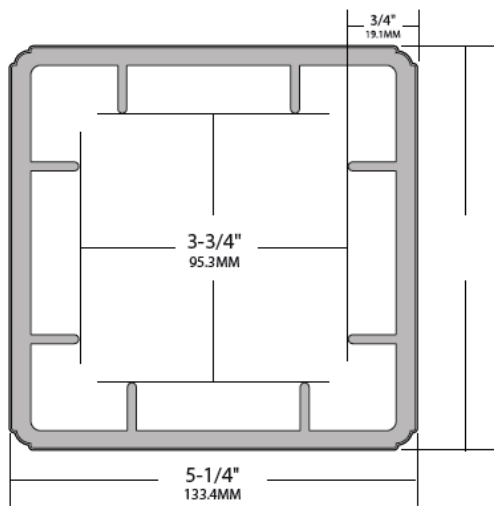


FIGURE 7 – 5-1/4" X 5-1/4" POST SLEEVE

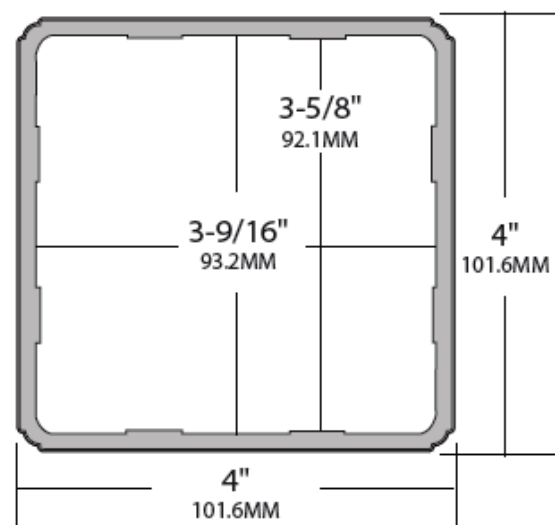


FIGURE 8 – 4" X 4" POST SLEEVE

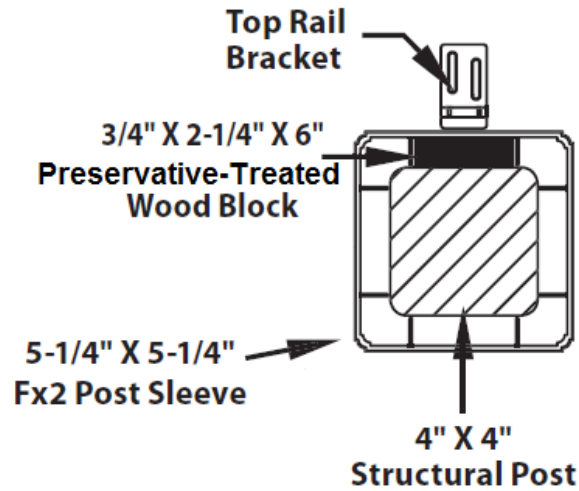


FIGURE 9 – POST SLEEVE INTERNAL DETAIL FOR 5-1/4" SQUARE POST SLEEVE



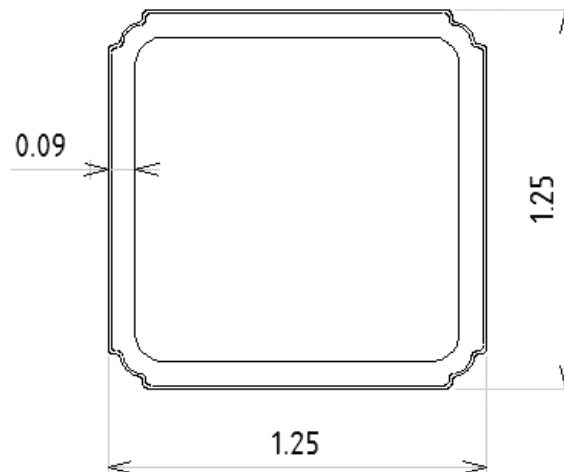


FIGURE 10 – SQUARE WPC BALUSTER



**FIGURE 11 – PIN GRIP BALUSTER CONNECTOR**

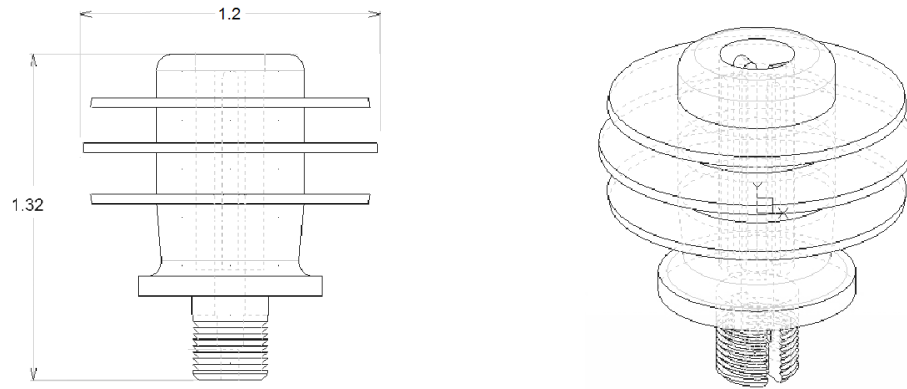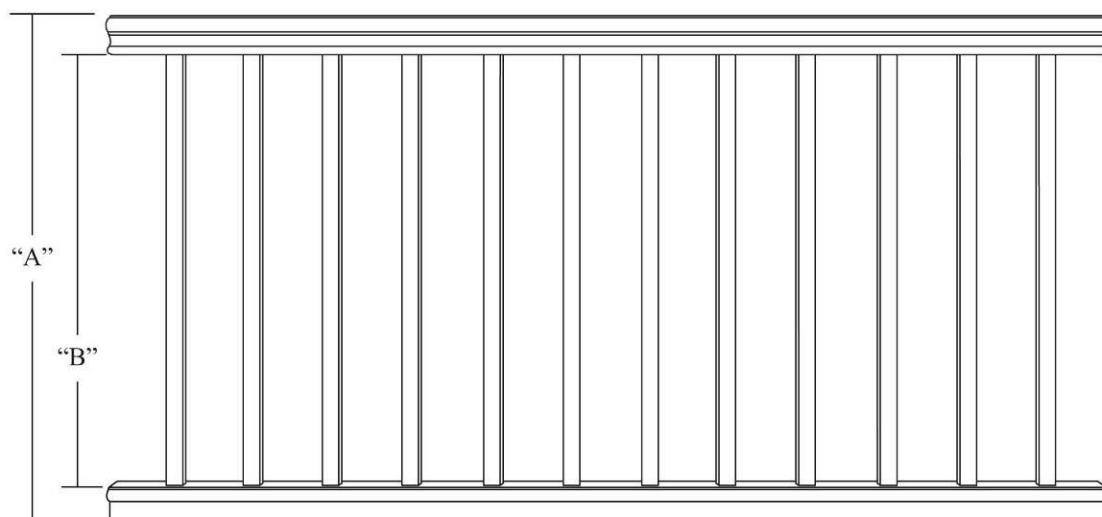

30" Balusters (36" Rail Height)

"A" - 34-1/8"      "B" - 29-1/2"  
866.8mm              749.3mm

36" Balusters (42" Rail Height)

"A" - 40-1/8"      "B" - 35-1/2"  
1019.2mm              901.7mm

**FIGURE 12 – GUARDRAIL ASSEMBLY**